

Interstate 10 at Monroe Street

Interchange Improvements

In the City of Indio

Project No. C7-0048

Federal Aid No. STPLN-5956(294)




Imperial Irrigation District (IID)

Relocation Plans

Notice regarding these Plans:


These plans are provided for reference only.

Although this information represents the latest information available, the County of Riverside Transportation Department does not guarantee the accuracy of this data.

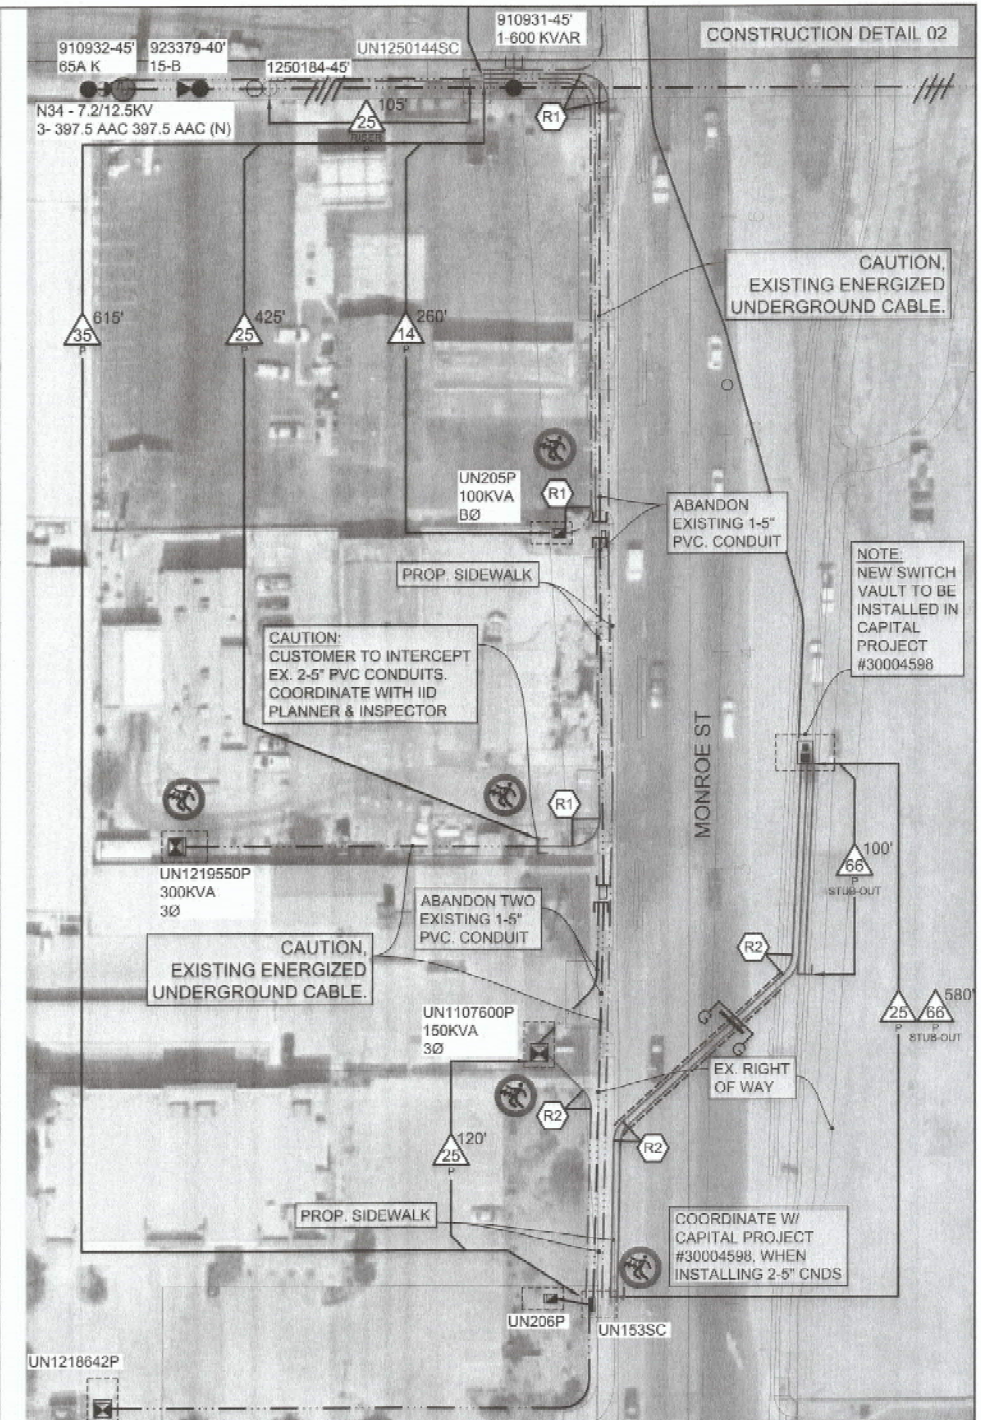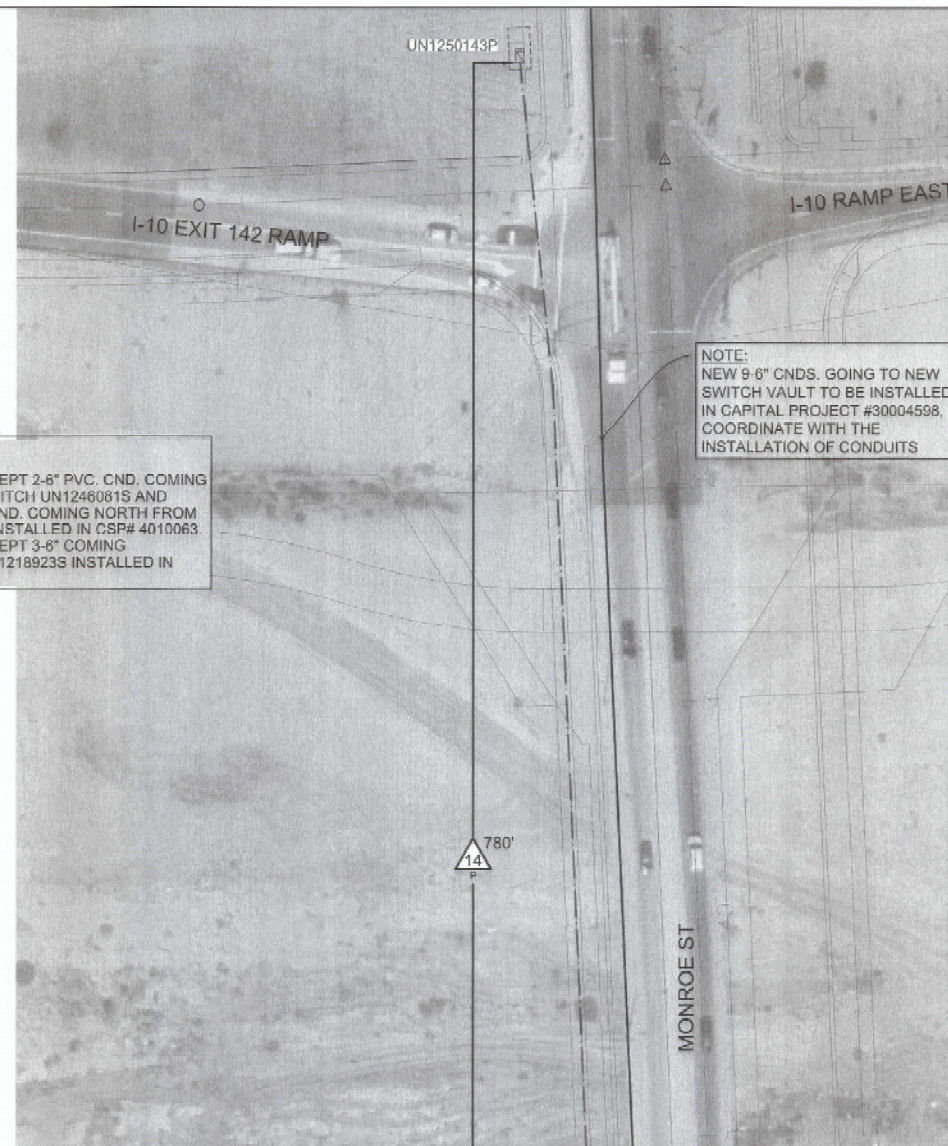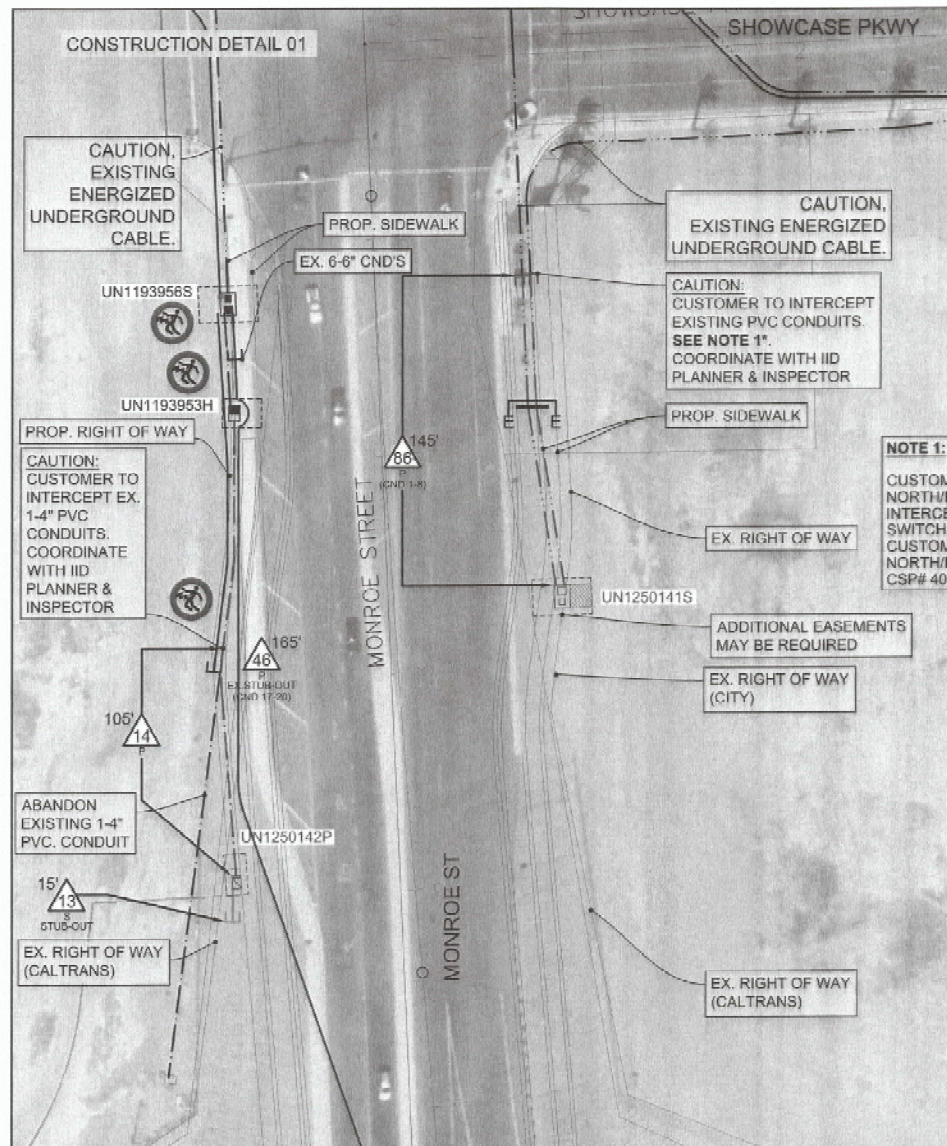


- CONDUIT NOTES:**
- 13 S
STUB-OUT
INSTALL 1-3" CND SCH.40 PVC PER SHOWN LENGTH.
(REFER TO SHEETS 10-11, 111-125 OF THE D.E.P.G. REV. 6 2025)
 - 14 P
INSTALL 1-4" CND SCH.40 PVC PER SHOWN LENGTH.
(REFER TO SHEETS 10-11, 111-123 OF THE D.E.P.G. REV. 6 2025)
 - 25 P
CUST. IN-2-5" X 90" SWEEP SCH. 80 PVC & 1-5" CND SCH.80 PVC (10' ABOVE FINISHED GRADE) (REFER TO SHEET 262 & 263 OF THE D.E.P.G. REV. 6 2025) 1-5" CND SCH.40 PVC STUB OUT AT BASE OF POLE. (REFER TO SHEET 124 & 125 OF THE D.E.P.G. REV. 6 2025)
 - 25 P
INSTALL 2-5" CND SCH.40 PVC PER SHOWN LENGTH.
(REFER TO SHEETS 10-11, 111-123 OF THE D.E.P.G. REV. 6 2025)
 - 35 P
INSTALL 3-5" CND SCH.40 PVC PER SHOWN LENGTH.
(REFER TO SHEETS 10-11, 111-123 OF THE D.E.P.G. REV. 6 2025)
 - 36 P
STUB-OUT
INSTALL 3-6" CND SCH.40 PVC PER SHOWN LENGTH.
(REFER TO SHEETS 10-11, 111-125 OF THE D.E.P.G. REV. 6 2025)
 - 46 P
STUB-OUT
INSTALL 4-6" CND SCH.40 PVC PER SHOWN LENGTH.
(REFER TO SHEETS 10-11, 111-125 OF THE D.E.P.G. REV. 6 2025)
 - 66 P
INSTALL 6-6" CND SCH.40 PVC PER SHOWN LENGTH.
(REFER TO SHEETS 10-11, 111-123 OF THE D.E.P.G. REV. 6 2025)

- TRENCHING NOTES:**
- TYPICAL: CONTRACTOR SHALL INSTALL 2" LINE GUARD TAPE (RED)
"CAUTION: BURIED ELECTRIC LINE BELOW."
(REFER TO SHEET 124 OF THE D.E.P.G. REV. 6 2025)
TYPICAL: 7" FROM FACE OF CURB TO CENTER OF TRENCH.
CONDUITS SHALL BE INSTALLED WITHIN 10' R/W UNLESS OTHERWISE NOTES.
(REFER TO SHEET 113 OF THE D.E.P.G. REV. 6 2025)
- ADDITIONAL EASEMENTS REQUIRES AT LARGE SWITCH VAULT LOCATIONS FOR IID MAINTENANCE AND OPERATION.
(REFER TO SHEETS 210-212, 219-221 OF THE D.E.P.G. REV. 6 2025)
- STRUCTURE DETAILS:**
- 0 PRECAST PAD FOR SINGLE PHASE TRANSFORMER
REFER TO SHEETS 158-165, 176, 179-181, 210-215 OF THE D.E.P.G. REV. 6 2025
 - 000 LARGE SWITCH PAD
REFER TO SHEETS 192-193, 210-212, 219-221 OF THE D.E.P.G. REV. 6 2025
 - 000 CAUTION ENERGIZED STRUCTURES:
DO NOT PERFORM ANY TYPE OF WORK ON OR AROUND ENERGIZED STRUCTURES. CONTACT IID INSPECTION LINE @ 760-398-5828

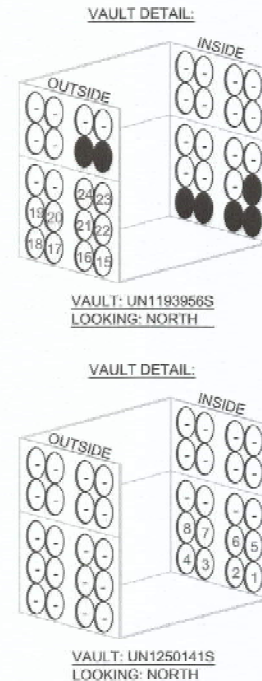

NOTE: CONTRACTOR/DEVELOPER

CAUTION: ENERGIZED STRUCTURE & CABLE: A QUALIFIED IID ELECTRICAL WORKER MUST BE ON SITE BEFORE ANY WORK IS PERFORMED ON OR AROUND STRUCTURES. PLEASE COORDINATE WITH IID PLANNER AND INSPECTOR.

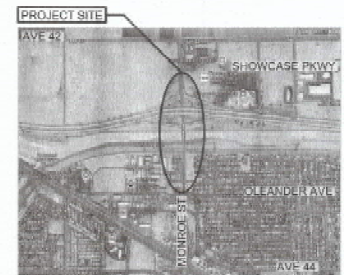

ACCEPTED FOR USE BY:

[Signature]

3/17/2026

DATE

AZAM JUNAID
SENIOR CIVIL ENGINEER
COUNTY OF RIVERSIDE TRANSPORTATION DEPARTMENT

SCALE: 1:50
T.7, R.7, SEC.19
RIVERSIDE COUNTY TLM
CONDUIT LAYOUT
N34-N145 (DATE: 11/24/2025) | SHEET 1 OF 1