


**SIDWALK ADJACENT TO CURB**

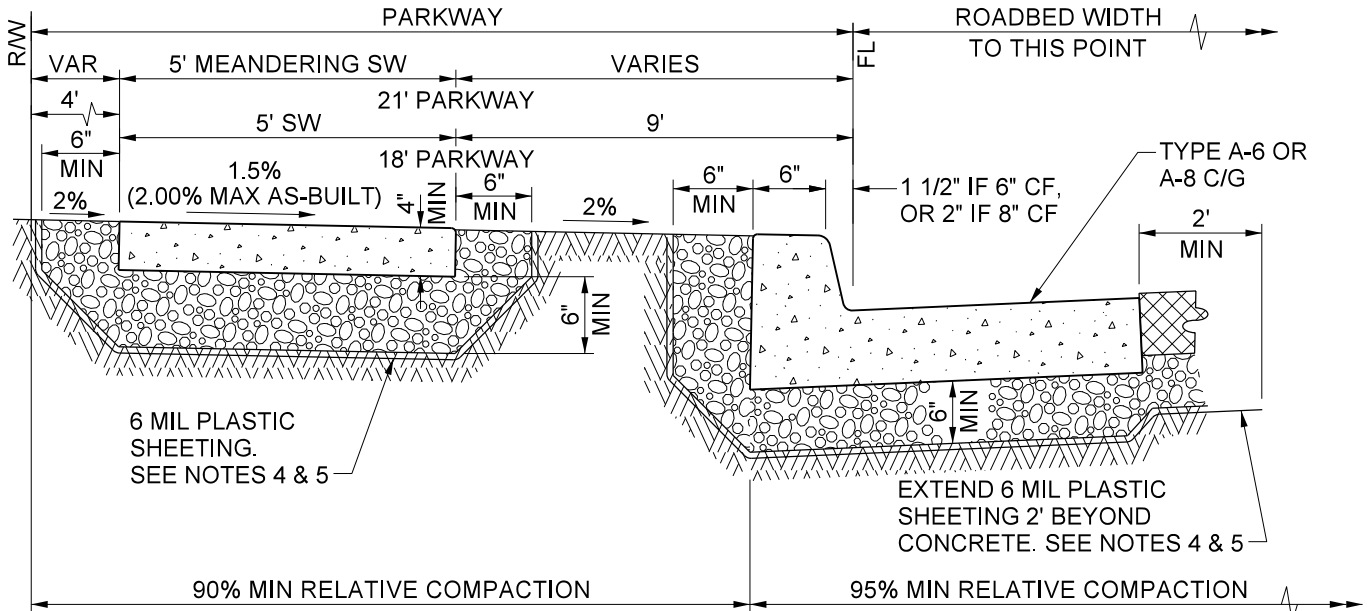

**MEANDERING SIDWALK IN 21' PARKWAY  
SIDWALK NOT ADJACENT TO CURB IN 18' PARKWAY**

**NOTES:**

1. ALL CONSTRUCTION SHALL BE CONCRETE WITH MINIMUM CEMENTITIOUS MATERIAL CONTENT = 505 LB/CU YD.
2. TO MAINTAIN PUBLIC PEDESTRIAN ACCESS, TEMPORARY TRAP FENCES FOR MODEL HOMES SHALL BE PLACED BEHIND PUBLIC SIDEWALK AND NOT BETWEEN PUBLIC SIDEWALK AND CURB.
3. FOR EXPANSIVE SOIL, PLACE 6" MIN CLASS 2 AGGREGATE BASE UNDER CONCRETE IMPROVEMENTS AS DIRECTED BY THE ENGINEER. SEE STANDARD SPECIFICATIONS SECTION 16.03.
4. WHEN ABUTTING SOIL HAS A HIGH SULFATE CONTENT, USE MODIFIED CONCRETE MIX AND PLACE 6" MIN CLASS 2 AGGREGATE BASE AND 6 MIL PLASTIC SHEETING UNDER AND AROUND ALL SIDES OF CONCRETE IMPROVEMENTS AND STRUCTURES. SEE COUNTY STANDARD SPECIFICATION SECTION 16.04.
5. WHEN USING 6 MIL PLASTIC SHEETING, PLACE THE SHEETING BETWEEN THE CLASS 2 AGGREGATE BASE AND THE COMPACTED NATIVE SOIL. EXTEND THE SHEETING 2 FEET BEYOND THE EDGE OF CONCRETE GUTTER INTO THE ROADWAY. IN ORDER TO PREVENT DAMAGE TO THE PLASTIC SHEETING RESULTING FROM LATER GRADING AND COMPACTING, PLACE THE EXTENDED 2 FEET OF SHEETING ONLY AFTER THE SUBGRADE HAS BEEN CERTIFIED BY THE SURVEYOR.

NOT TO SCALE

PREPARED UNDER THE SUPERVISION OF:

*Mark Lancaster*

11/30/22  
DATE

DIRECTOR OF TRANSPORTATION  
MARK LANCASTER, P.E.



COUNTY OF RIVERSIDE

**SIDWALK AND CURB**

**STANDARD No. 401**

REVISION	DESCRIPTION	MARK	DATE	APPROVED